
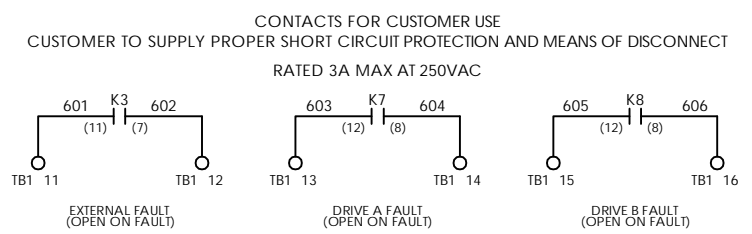
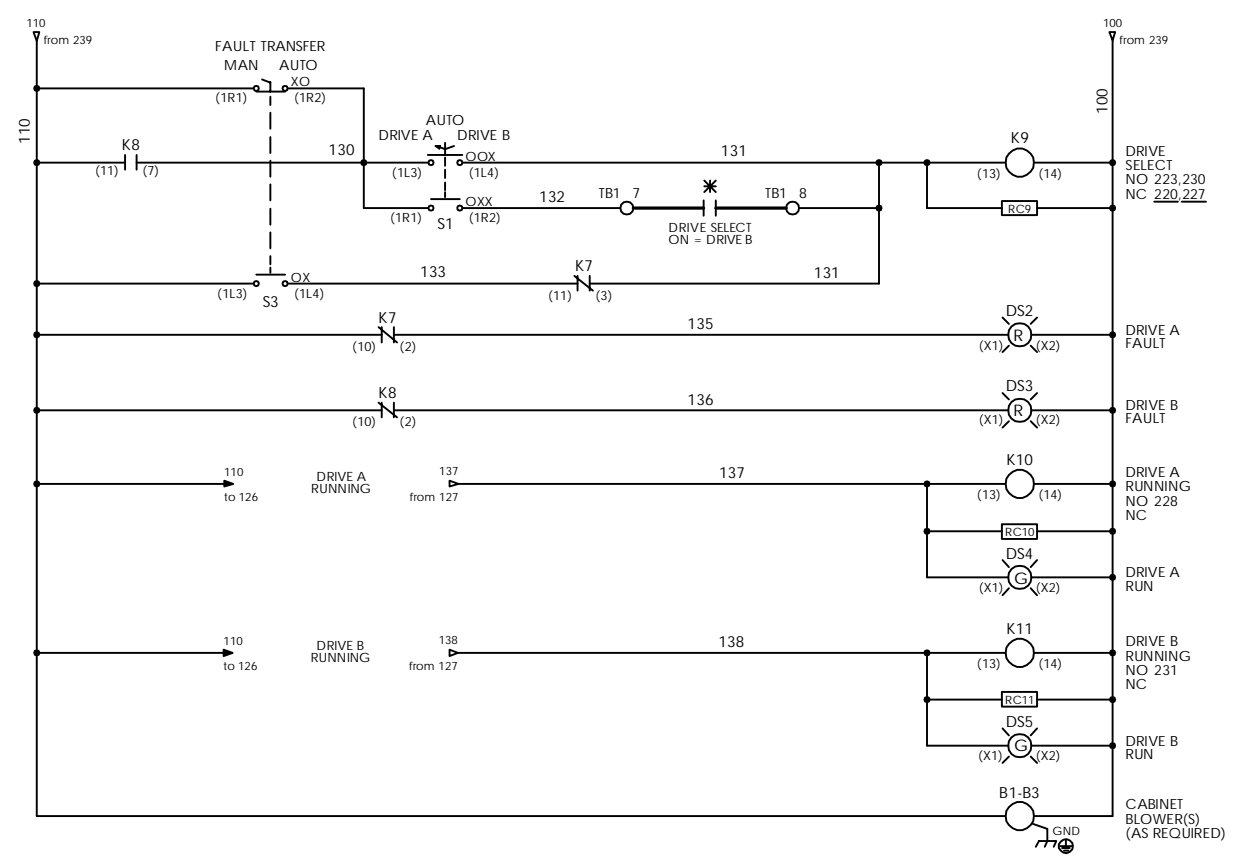


* COMPONENTS NOT SUPPLIED BY YASKAWA.
 — CUSTOMER WIRING. -FOR 0-100 AMPS, USE A MINIMUM OF 60° - 75°C COPPER WIRE.
 ABOVE 100 AMPS, USE A MINIMUM OF 75°C COPPER WIRE.

YASKAWA		DATE	8/8/22	TITLE	SCHEMATIC DIAGRAM
DRAWN BY	K.LEIN	DATE	8/8/22	CHECKED	A.JANDRIN
APPROVED	R.JENSEN	DATE	8/9/22	DATE	8/8/22
ORIGINAL DESIGN	K.LEIN	DATE	8/8/22	SIZE	B
				REVISION	00
				PAGE	1 of 3
DRAWING #		DS.H6R112.01			

REV.	DESCRIPTION	ECO #	DRAWN BY	DATE
00	INITIAL RELEASE	-	K.LEIN	8/8/22

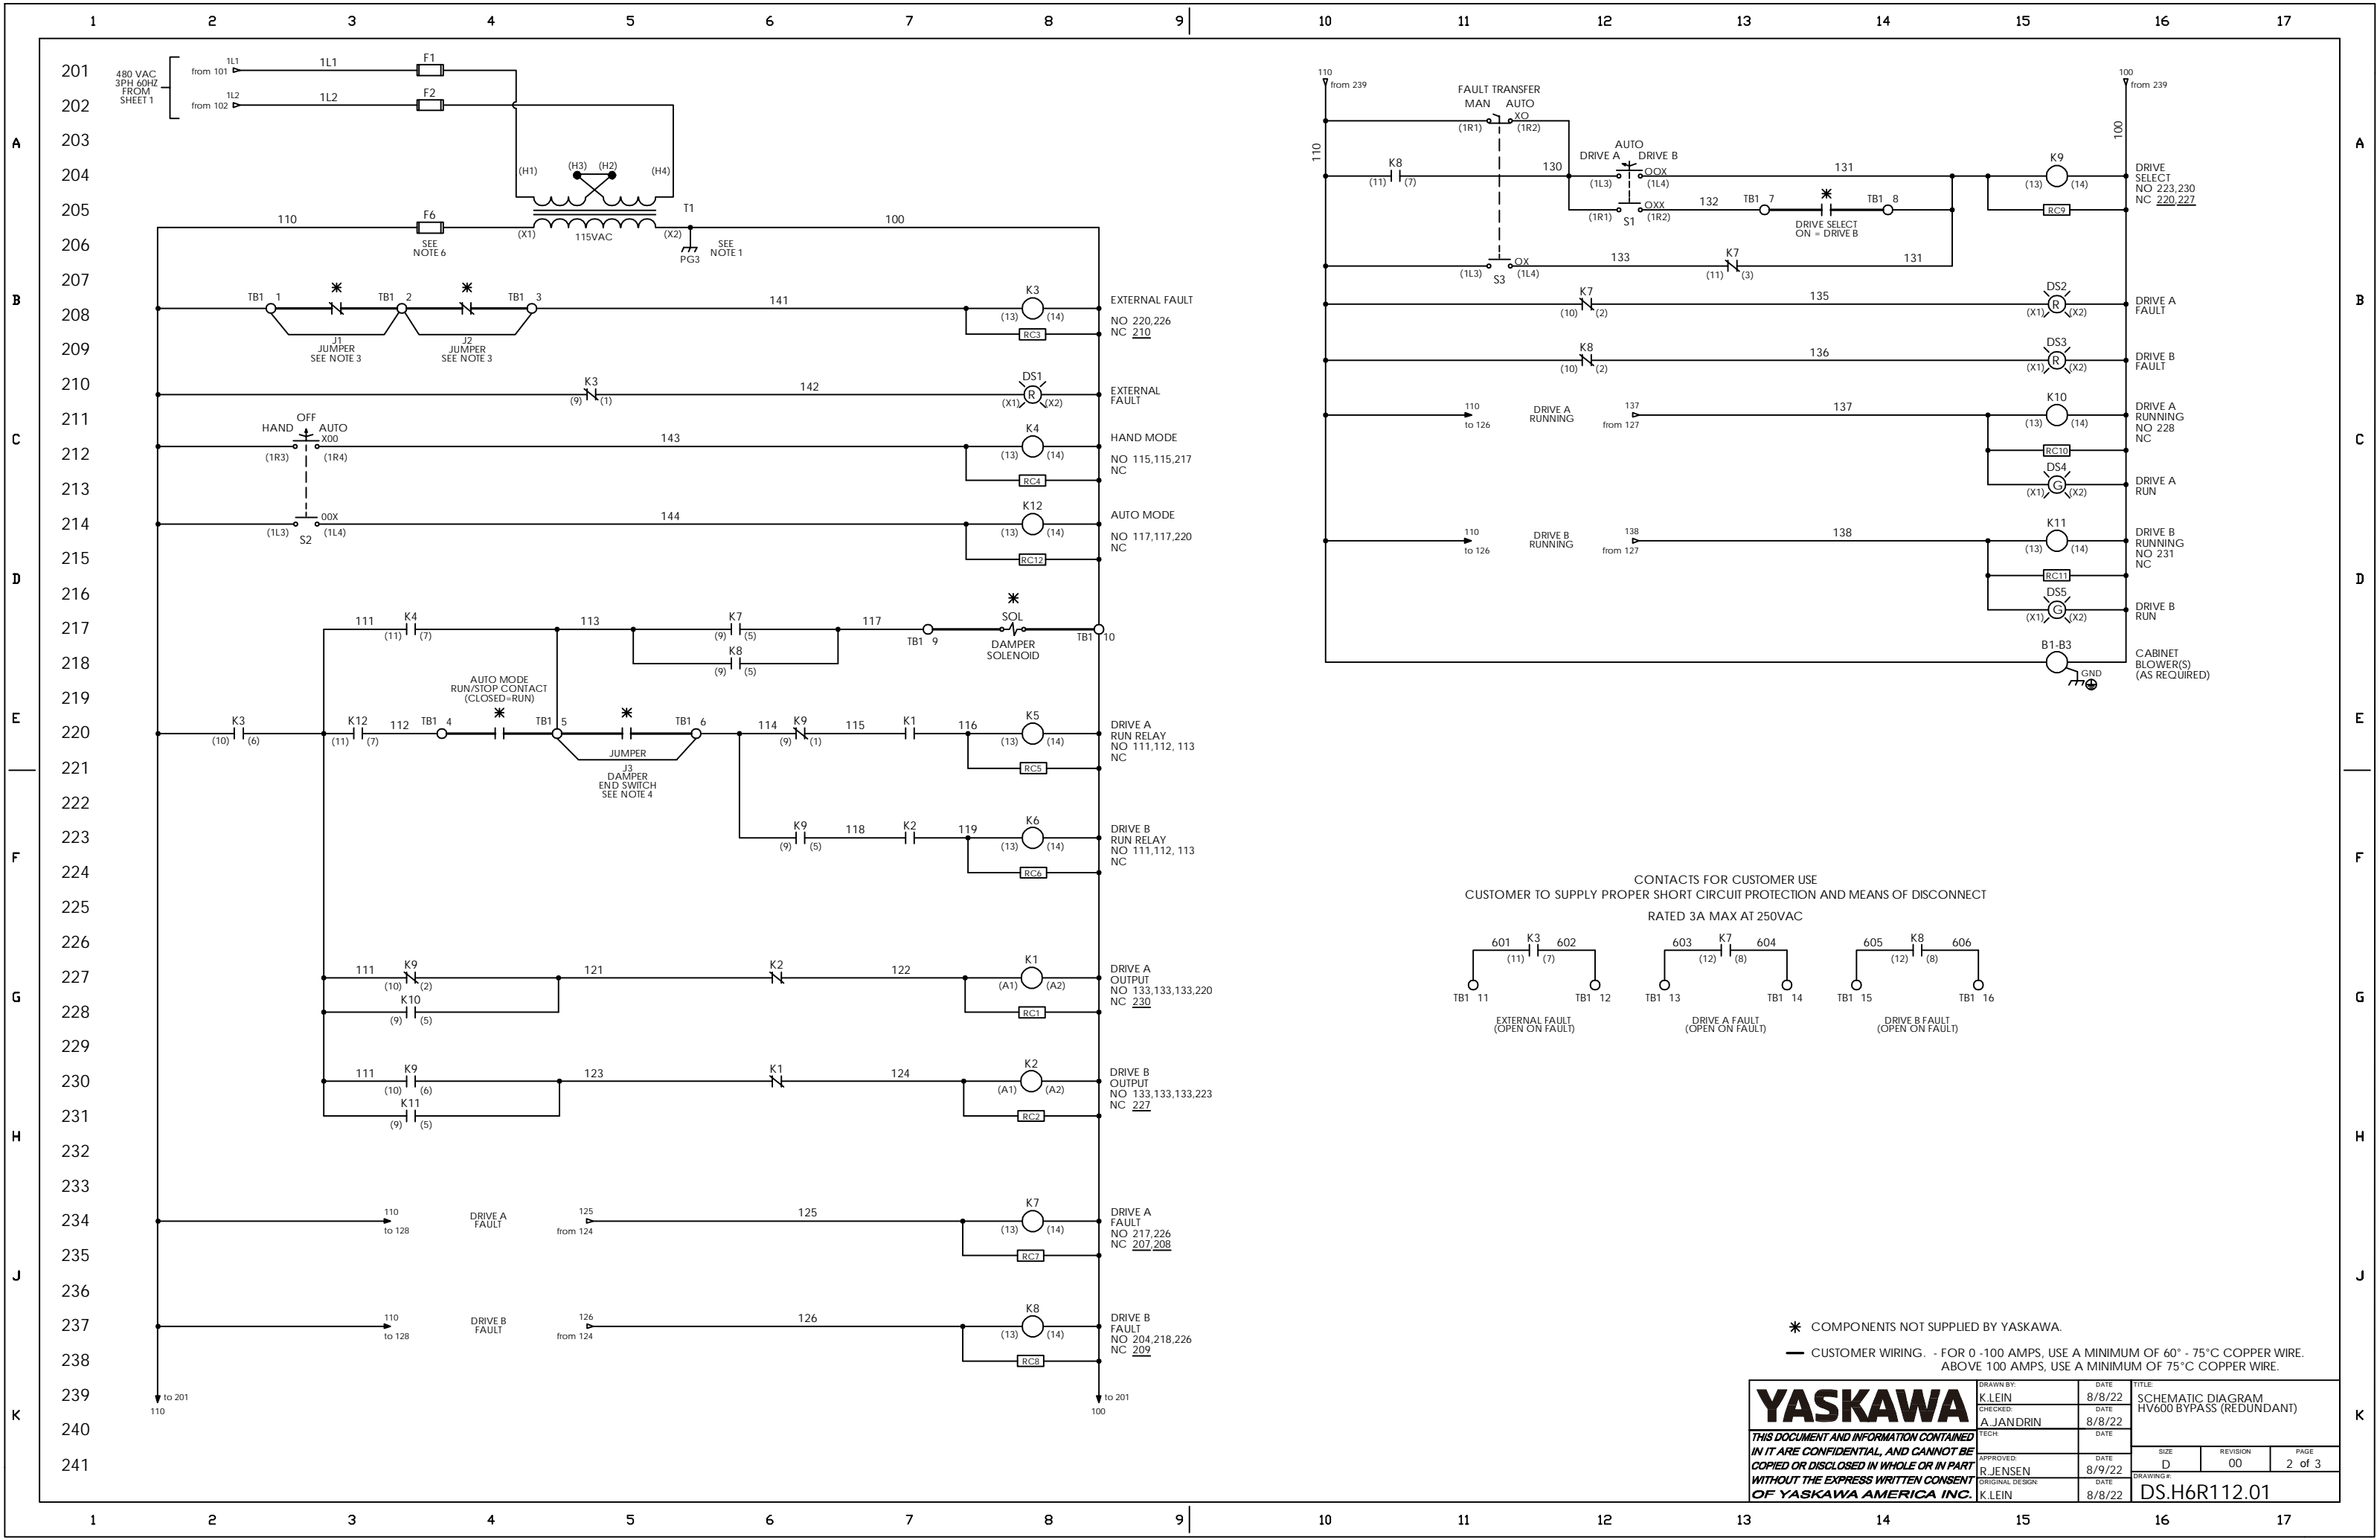

* COMPONENTS NOT SUPPLIED BY YASKAWA.
— CUSTOMER WIRING. - FOR 0 -100 AMPS, USE A MINIMUM OF 60° - 75°C COPPER WIRE.
ABOVE 100 AMPS, USE A MINIMUM OF 75°C COPPER WIRE.

YASKAWA	DRAWN BY:	K.LEIN	DATE:	8/8/22	TITLE:	SCHEMATIC DIAGRAM				
	CHECKED:	A.JANDRIN	DATE:	8/8/22		HV600 BYPASS (REDUNDANT)				
THIS DOCUMENT AND INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND NOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.	TECH:		DATE:		SIZE:	D	REVISION:	00	PAGE:	2 of 3
	APPROVED:	R.JENSEN	DATE:	8/9/22	DRAWING#:	DS.H6R112.01				
	ORIGINAL DESIGN:	K.LEIN	DATE:	8/8/22						

NOTES:

- CONNECTED TO THE CABINET. CUSTOMER TO CONNECT THE CABINET GROUND LUG TO EARTH GROUND.
- BRANCH CIRCUIT PROTECTION (CIRCUIT BREAKER OR FUSES) MUST BE SUPPLIED BY CUSTOMER.
- TERMINALS SUPPLIED FOR INSERTION OF NORMALLY CLOSED CUSTOMER SAFETY CONTACTS (I.E., FIRESTAT, FREEZESTAT, WINDING OR BEARING TEMPERATURE ACTIVATED SWITCHES). IF APPLICABLE, REMOVE FACTORY INSTALLED JUMPER J1 OR J2.
- TERMINALS SUPPLIED FOR INSERTION OF CUSTOMER SUPPLIED, NORMALLY OPEN DAMPER END SWITCH (OPEN = DAMPER CLOSED, CLOSED = DAMPER FULLY OPEN), OR BUILDING AUTOMATION SYSTEM (BAS) INTERLOCK. IF APPLICABLE, REMOVE FACTORY INSTALLED JUMPER J3.
- INSULATED TWISTED SHIELDED WIRE IS REQUIRED. 2 CONDUCTOR #18GA. (BELDON #8760, OR EQUIVALENT). SHIELD TO CONNECT TO PROPER TERMINAL AS SHOWN. CONNECT THE SHIELD ONLY AT THIS END. STUB AND ISOLATE THE OTHER END. DO NOT RUN THESE WIRES IN THE SAME CONDUIT AS THE AC POWER AND AC CONTROL WIRES.
- FOR DRIVE CABINETS WITH A CONTROL TRANSFORMER, T1, POWER RATING OF 350VA OR GREATER, SECONDARY FUSE F6 IS ADDED.
- HAND/OFF/AUTO SWITCH OPERATION:**
THE FUNCTION OF THE HAND/OFF/AUTO SWITCH IS TO SELECT SPEED AND RUN/STOP CONTROL. THE AUTO POSITION SELECTS THE AUTO SIGNAL INPUT FOR SPEED AND A CUSTOMER SUPPLIED CONTACT FOR A RUN COMMAND. THE HAND POSITION SELECTS THE DRIVE KEYPAD FOR SPEED AND RUN COMMAND.
- DRIVE A/AUTO/DRIVE B SWITCH OPERATION:**
THE FUNCTION OF THIS SWITCH IS TO SELECT THE DRIVE THAT RUNS IN THE "AUTO" POSITION. A CUSTOMER CONTACT SELECTS THE DRIVE. DRIVE B IS SELECTED WHEN THE CONTACT IS CLOSED.
- MANUAL/AUTO FAULT TRANSFER SWITCH OPERATION:**
THE FUNCTION OF THIS SWITCH IS TO SELECT THE METHOD OF TRANSFERRING TO THE SECOND DRIVE WHEN THE FIRST DRIVE FAILS. IN THE AUTO TRANSFER POSITION, THE LOGIC WILL AUTOMATICALLY TRANSFER FROM THE DRIVE RUNNING TO THE SECOND DRIVE WHEN THE FIRST DRIVE FAILS. IN THE MANUAL POSITION, THE OPERATOR MUST SELECT THE SECOND DRIVE TO RUN VIA THE DRIVE A/AUTO/DRIVE B SELECTOR SWITCH.
- WHEN USING OPTION T3, ATTACH TO CN5 ON DRIVE AND TO MAKE SURE THE DIP SWITCHES ARE CONFIGURED TO BACnet/IP SETTINGS, SEE APPROPRIATE TECHNICAL MANUAL FOR EXTERNAL CONNECTIONS AND SETTINGS
- H6R1 MODEL NUMBER PREFIX INDICATES UL TYPE 1 ENCLOSURE.
H6R2 MODEL NUMBER PREFIX INDICATES UL TYPE 12 ENCLOSURE.

TABLE 1 - FACTORY SET HV600 BYPASS (REDUNDANT DRIVE) PARAMETERS

PARAMETER	DATA	UNIT	DESCRIPTION/REMARKS
b1-08	1	N/A	RUN COMMAND SELECTION IN PROGRAMMING MODE = ENABLED
b3-01	1	N/A	SPEED SEARCH SELECTION AT START = ENABLED
b3-05	3.0	SEC.	SPEED SEARCH DELAY TIME
d1-01	10.0	HZ	FREQUENCY REFERENCE 1 (HAND MODE)
d2-01	----	%	FREQUENCY REFERENCE UPPER LIMIT (MUST BE SET BY USER)
d2-02	----	%	FREQUENCY REFERENCE LOWER LIMIT (MUST BE SET BY USER)
E1-01	480	V	INPUT VOLTAGE SETTING (MUST BE SET BY USER)
E1-04	----	HZ	MAXIMUM OUTPUT FREQUENCY (MUST BE SET BY USER)
E1-05	460	V	MAXIMUM OUTPUT VOLTAGE SETTING
E2-01	----	AMPS	MOTOR RATED FLA CURRENT (MUST BE SET BY USER)
H1-05	6E	N/A	DIGITAL INPUT TERMINAL S5 FUNCTION SELECTION = HAND MODE SELECT
H1-06	18	N/A	DIGITAL INPUT TERMINAL S6 FUNCTION SELECTION = TIMER FUNCTION INPUT (POWER ON)
H1-07	6D	N/A	DIGITAL INPUT TERMINAL S7 FUNCTION SELECTION = AUTO MODE SELECT
H2-01	0	N/A	TERMINAL M1-M2 FUNCTION SELECTION = DURING RUN
H2-02	12	N/A	TERMINAL M3-M4 FUNCTION SELECTION = TIMER OUTPUT (POWER ON)
H3-03	0.0	%	TERMINAL A1 GAIN SETTING
H3-09	2	N/A	TERMINAL A2 SIGNAL LEVEL SELECTION = 4-20mA
L4-05	0	N/A	FREQUENCY REFERENCE LOSS DETECTION SELECTION = STOP
L5-01	10	N/A	NUMBER OF AUTO RESTART ATTEMPTS
L5-03	5.0	SEC.	TIME TO CONTINUE MAKING FAULT RESTARTS (TIME BETWEEN AUTO RESTART ATTEMPTS)
o3-02	1	N/A	COPY ALLOWED SELECTION = ENABLED
S5-01	1	N/A	HAND FREQUENCY REFERENCE SELECTION = S5-05
S5-04	1	N/A	HAND MODE BEHAVIOR SELECTION = NORMAL (STANDARD)
S5-05	10	HZ	HAND FREQUENCY REFERENCE 1
S5-07	0	N/A	HAND KEY FUNCTION SELECTION = DISABLED

CUSTOMER WIRING REQUIREMENTS

- FOR 0 TO 100 AMPS, USE A MINIMUM OF 60° - 75°C COPPER WIRE.
- FOR ABOVE 100 AMPS, USE A MINIMUM OF 75°C COPPER WIRE. (UNLESS SPECIFIED OTHERWISE)

TABLE 2

BASE PART NUMBER (NOTE 11)	HP	OUTPUT CURRENT (AMPS)	A.C. LINE WIRING DISCONNECT SWITCH (S11)				OPTION PM - A.C. LINE WIRING CIRCUIT BREAKER (CB1)				INPUT FUSES F3-F5, F7-F9		A.C. MOTOR WIRING TERMINAL BLOCK (TB2)		CONTROL WIRING TERMINAL BLOCK (TB1)		EARTH GROUND WIRING GROUND LUG	
			MFG. PART NUMBER	CURRENT RATING (AMPS)	WIRE SIZE RANGE (AWG)	TIGHTENING TORQUE (LB-IN)	MFG. PART NUMBER	CURRENT RATING (AMPS)	WIRE SIZE RANGE (AWG)	TIGHTENING TORQUE (LB-IN)	MFG. PART NUMBER	CURRENT RATING (AMPS)	WIRE SIZE RANGE (AWG)	TIGHTENING TORQUE (LB-IN)	WIRE SIZE RANGE (AWG)	TIGHTENING TORQUE (LB-IN)	WIRE SIZE RANGE (AWG)	TIGHTENING TORQUE (LB-IN)
H6R_B004	3	4.8	OT30F3	30	14 - 4	55	HLL36015	15	14 - 10	50 - 120	FWH-40B	40	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B007	5	7.6	OT30F3	30	14 - 4	55	HLL36015	15	14 - 10	50 - 120	FWH-40B	40	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B011	7.5	11	OT30F3	30	14 - 4	55	HLL36020	20	14 - 10	50 - 120	FWH-45B	45	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B014	10	14	OT30F3	30	14 - 4	55	HLL36025	25	14 - 10	50 - 120	FWH-45B	45	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B021	15	21	OT60F3	60	14 - 4	55	HLL36035	35	14 - 10	50 - 120	FWH-60B	60	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B027	20	27	OT60F3	60	14 - 4	55	HLL36040	40	8 - 3/0	120	FWH-80B	80	14 - 4	35 - 45	26 - 10	5.3 - 7.1	10 - 4	35
H6R_B034	25	34	OT60F3	60	14 - 4	55	HLL36050	50	8 - 3/0	120	FWH-125B	125	14 - 4	35 - 45	26 - 10	5.3 - 7.1	8	40
H6R_B040	30	40	OT100F3	100	8 - 1/0	55	HLL36060	60	8 - 3/0	120	FWH-150B	150	14 - 4	35 - 45	26 - 10	5.3 - 7.1	8	40
H6R_B052	40	52	OT100F3	100	8 - 1/0	55	HLL36080	80	8 - 3/0	120	FWH-200B	200	6 - 2/0	120	26 - 10	5.3 - 7.1	6 - 4	45
H6R_B065	50	65	OT100F3	100	8 - 1/0	55	HLL36100	100	8 - 3/0	120	FWH-225A	225	6 - 2/0	120	26 - 10	5.3 - 7.1	6 - 4	45
H6R_B077	60	77	HGL36000S15	150	8 - 3/0	120	HLL36110	110	8 - 3/0	120	FWH-225A	225	6 - 2/0	120	26 - 10	5.3 - 7.1	6 - 4	45
H6R_B096	75	96	HGL36000S15	150	8 - 3/0	120	HLL36150	150	8 - 3/0	120	FWH-225A	225	6 - 2/0	120	26 - 10	5.3 - 7.1	6 - 4	45
H6R_B124	100	124	JGL36000S17	175	4 - 4/0	225	JLL36175M75	175	8 - 4/0	225	FWH-250A	250	6 - 350 kcmil	275	26 - 10	5.3 - 7.1	6 - 4	45
H6R_B156	125	156	JGM36000S25	250	3/0 - 350 kcmil	225	JLM36250	250	3/0 - 350 kcmil	225	FWH-300A	300	6 - 350 kcmil	275	26 - 10	5.3 - 7.1	14 - 2/0	120
H6R_B180	150	180	JGL36000S25	250	3/0 - 350 kcmil	225	JLL36250M75	250	3/0 - 350 kcmil	225	FWH-350A	350	6 - 350 kcmil	275	26 - 10	5.3 - 7.1	14 - 2/0	120
H6R_B240	200	240	LGM36000S40	400	(1-2) x (2/0 - 500 kcmil)	400	LLM36400U31X	400	(1-2) x (2/0 - 500 kcmil)	442	FWH-400A	400	4 - 500 kcmil	375	26 - 10	5.3 - 7.1	14 - 2/0	120
H6R_B302	250	302	LGL36000S40	400	(1-2) x (2/0 - 500 kcmil)	400	LLL36400U31X	400	(1-2) x (2/0 - 500 kcmil)	442	FWH-600A	600	(2)x (6 - 350 kcmil)	275	26 - 10	5.3 - 7.1	14 - 2/0	120

YASKAWA	DRAWN BY:	K.LEIN	DATE:	8/8/22	TITLE:	SCHEMATIC DIAGRAM HV600 BYPASS (REDUNDANT)		
	CHECKED:	A.JANDRIN	DATE:	8/8/22		SIZE:	REVISION:	PAGE:
THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL, AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.	TECH:		DATE:		DRAWING#:	DS.H6R112.01		
	APPROVED:	R.JENSEN	DATE:	8/9/22	DATE:	8/8/22		