


\* 12 Pulse Input Terminals R1/L11, S1/L21 and T1/L31 are standard on CIMR-P7U(2022 to 2110) and CIMR-P7U(4022 to 4300)  
 \*\* External Braking Terminal +3 is standard on CIMR-P7U(2022 to 2110) and CIMR-P7U(4022 to 4300)  
 \*\*\* Braking Terminals B1 and B2 & DC Reactor Terminals +1 and +2 are standard on CIMR-P7U(20P4 to 2018) and CIMR-P7U(40P4 to 4018)

Shorting Bar Standard for:  
 CIMR-P7U(20P4 to 2018) CIMR-P7U(2022 to 2110)  
 CIMR-P7U(40P4 to 4018) CIMR-P7U(4022 to 4300)  
 Remove if adding External DC Reactor

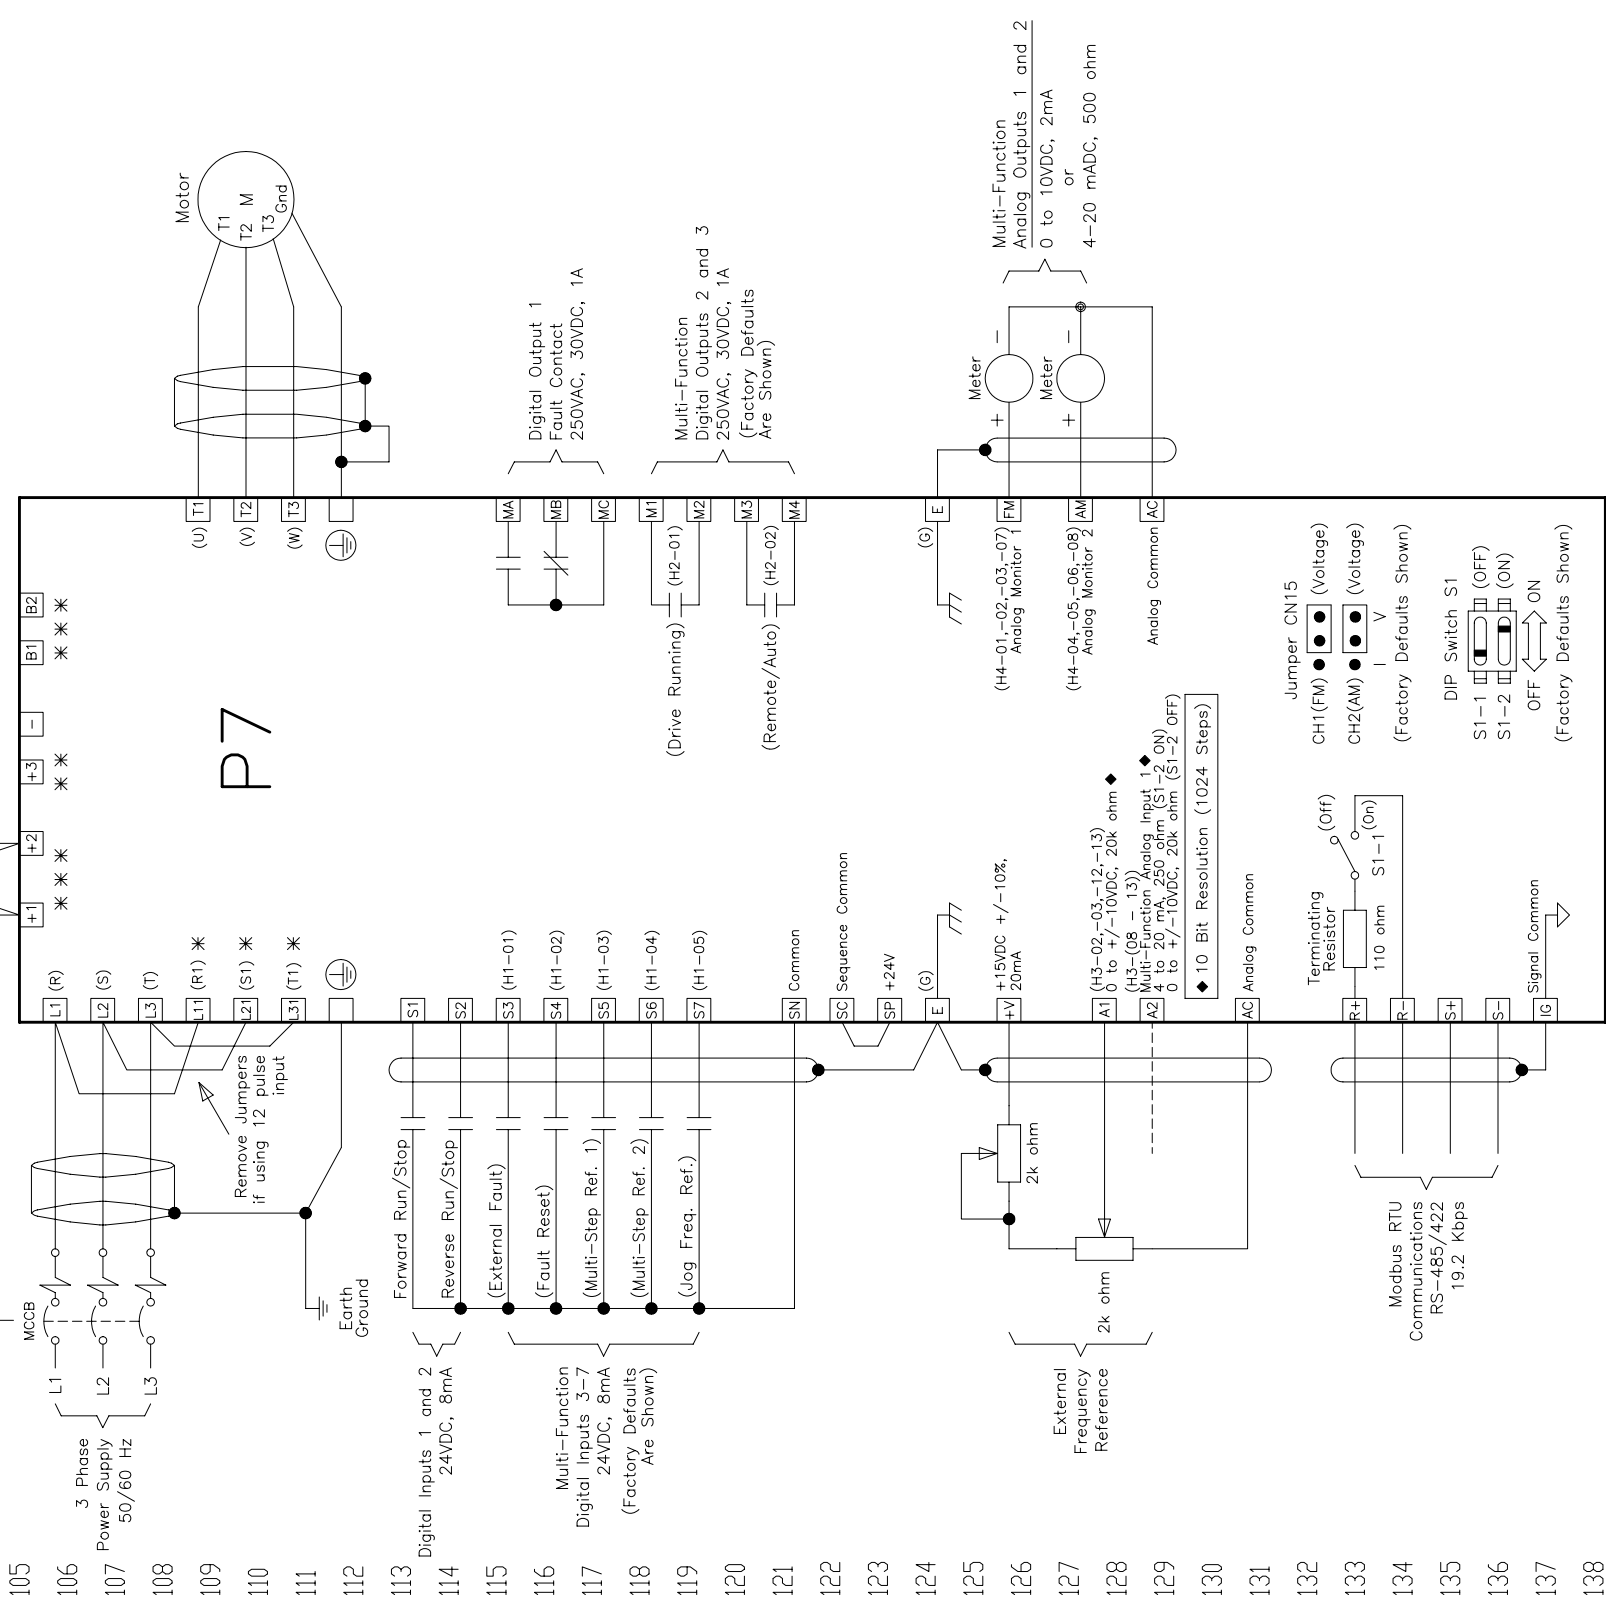

<b>YASKAWA</b> A World of Automation Solutions™		DESIGN BY D.R. CMELAK	DATE 11/16/05	TITLE P7 DRIVE
THIS DOCUMENT AND INFORMATION CONTAINED HEREIN ARE CONFIDENTIAL AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA ELECTRIC AMERICA, INC.		DESIGNED BY K. FLIERL	DATE 11/16/05	ELEMENTARY SCHEMATIC
APPROVED BY J. ZUEHLKE	DATE 11/16/05	REVISION D	SIZE D	PAGE R00
ORIGINAL DESIGNER D.R. CMELAK	DATE 11/16/05	DRAWING # DS.P7.01	REVISED BY R00	1 of 1